





- ASHP* - Bins and Air Source Heat Pump low level enclosure with planting
- Inground directional path lighting - shown indicatively number of fittings TBC
- Directional amenity lighting - shown indicatively number of fittings TBC
- Link lighting - User switch operated 10-20mins crossing time TBA
- Lit bollards to pavilion path

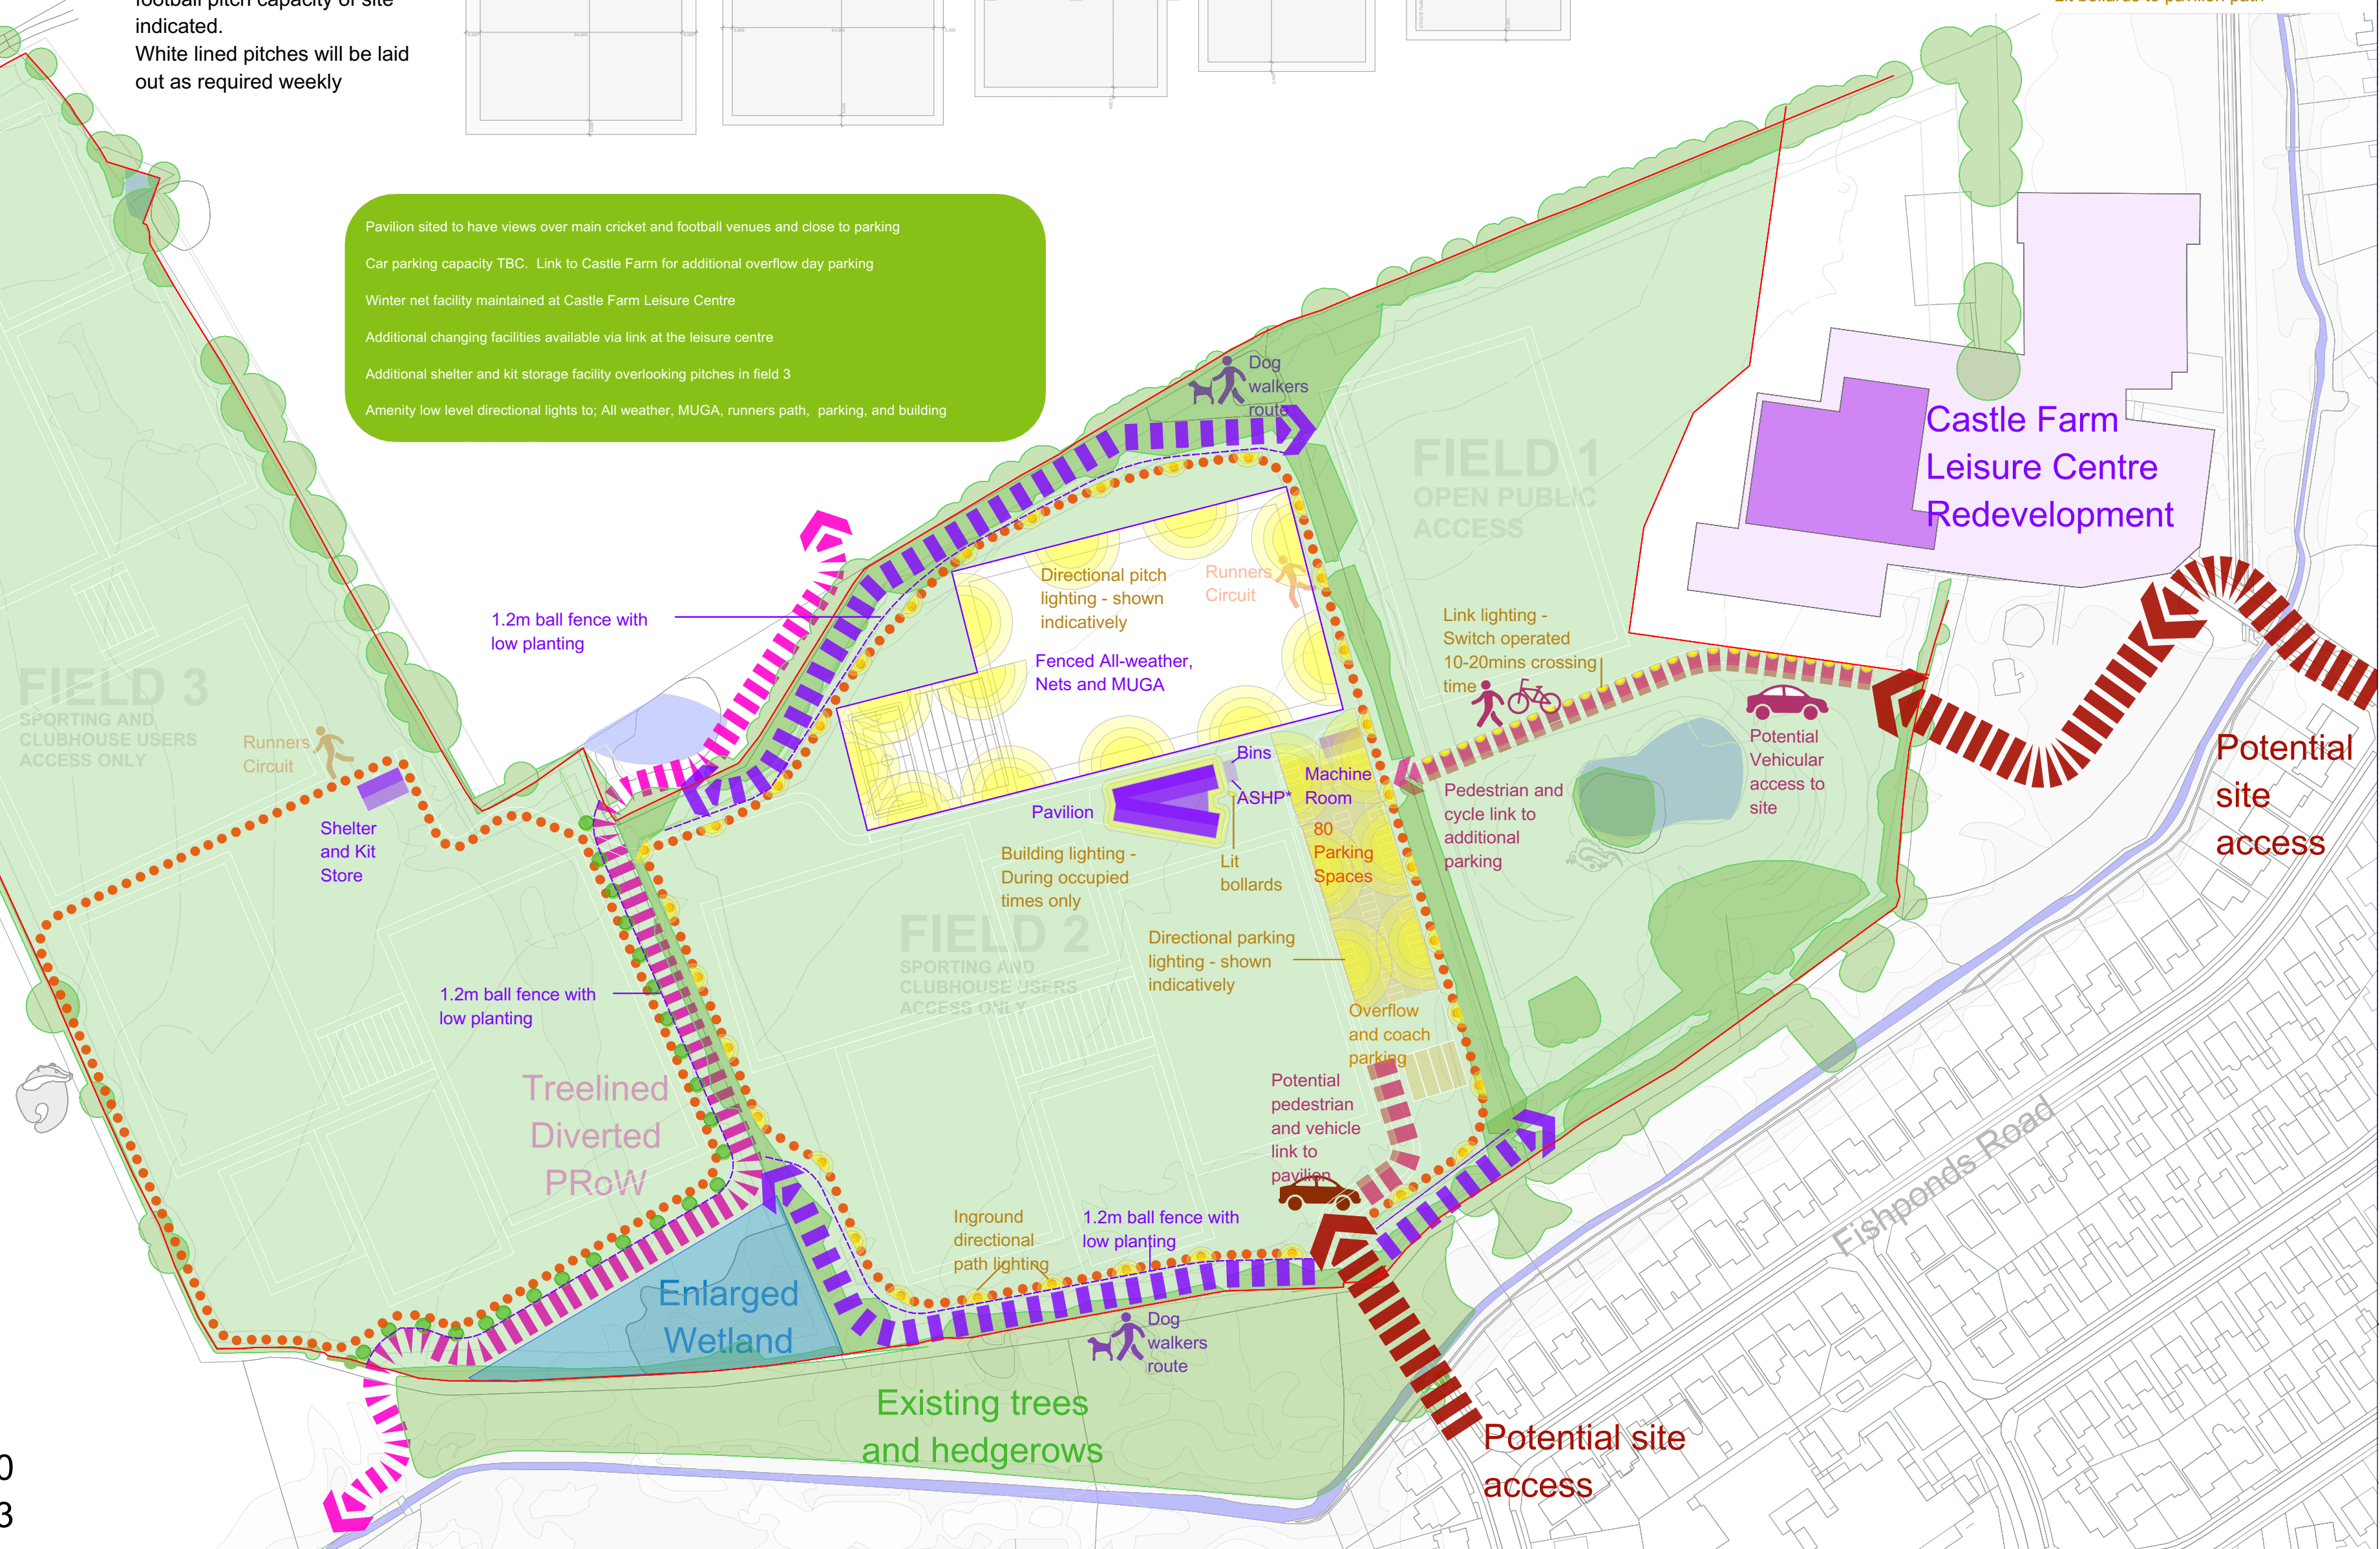

1 to 750 @ A0
1 to 2000 @ A3