


LICENSING KEY:

	Fire Alarm Control Panel		Illuminated Fire Exit sign
	Smoke detector		Break glass call point for fire alarm in accordance with BS5839
	Smoke detector/alarm		Fire door to provide min. 30 minutes fire protection
	Heat detector		Fire door to provide min. 30 minutes fire protection and where restricted smoke leakage at ambient temperatures is needed.
	Alarm sounder		Area for consumption of intoxicating liquor
	Emergency lighting in accordance with BS5266		Area for storage of liquor/bar counter
	Fire blanket 1m x 1m unless otherwise stated		Toilet accommodation
	6 litre fire foam extinguisher		Kitchen & staff areas
	10kg dry powder fire extinguisher		Visual beacon linked to the fire detection and alarm system so that a hearing impaired user can see a flashing warning
	Total extent of licensed premises		
	Fire door keep locked		
	Fire door keep closed		

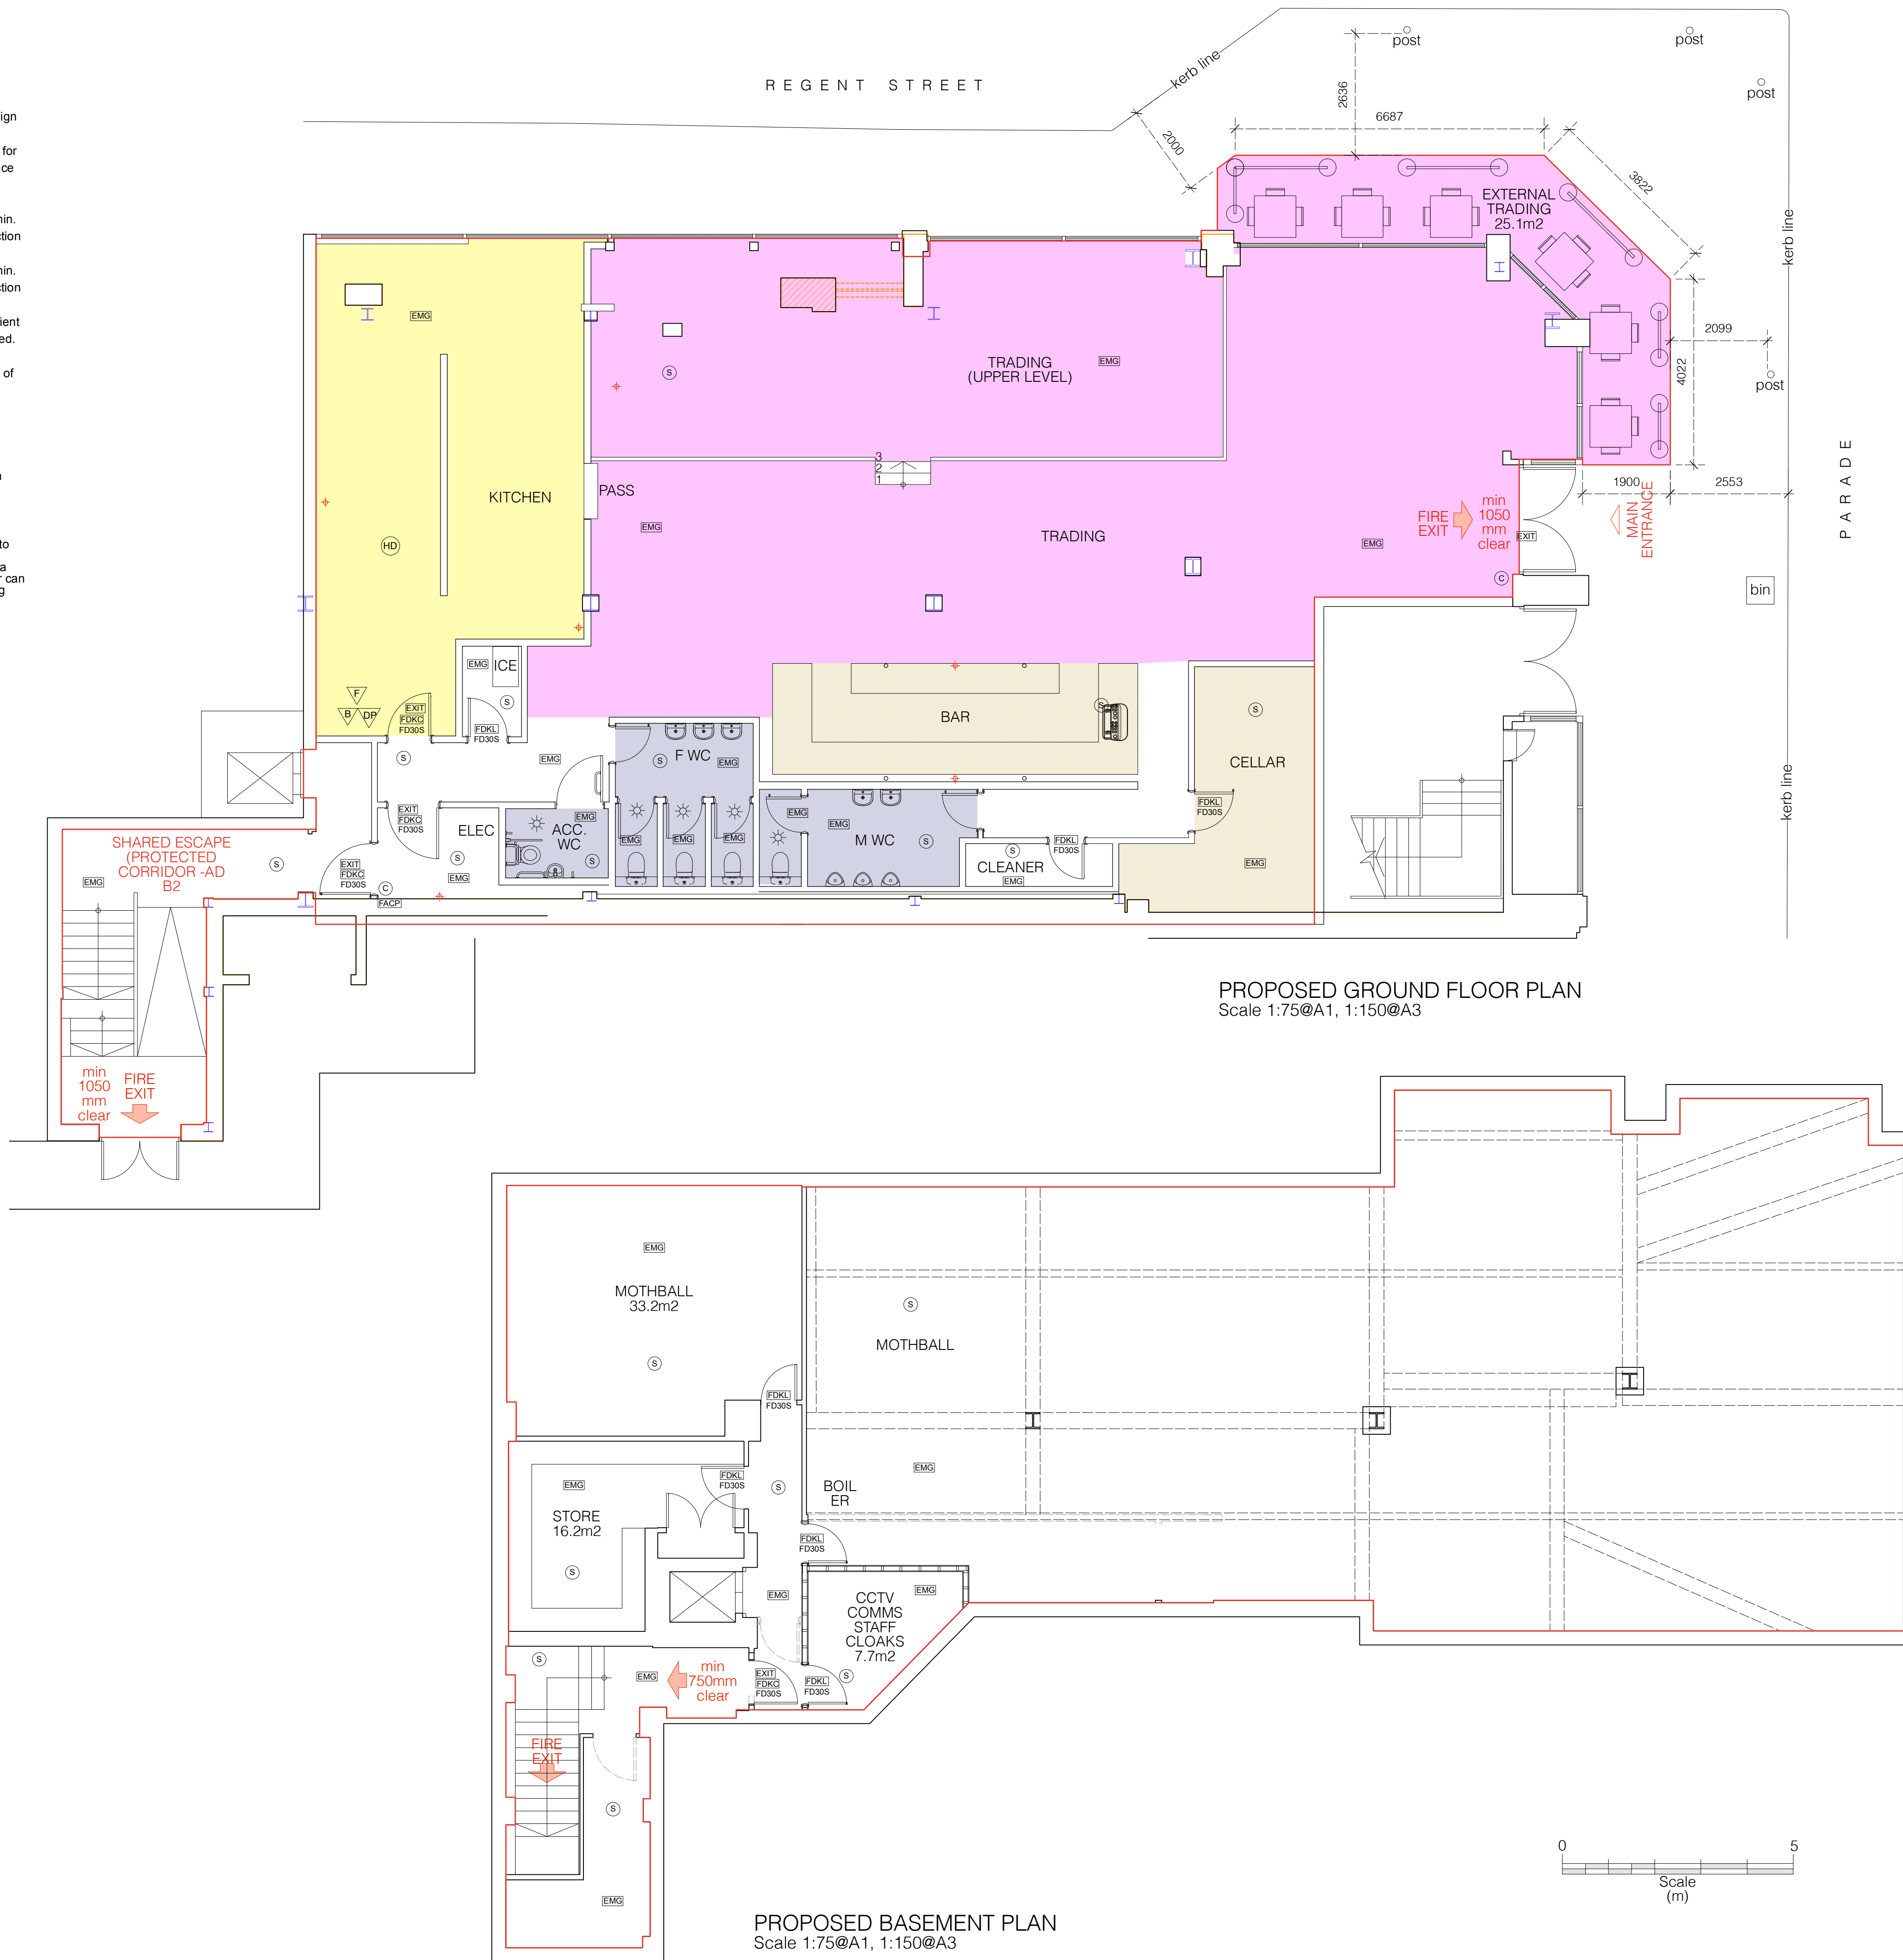

A 31.10.25 DR Updated to latest layout; external seating added
Rev Date Initials Details

Purpose of Issue
APPLICATION FOR PREMISES LICENSING

RICHARD PEDLAR ARCHITECTS
ARCHITECTURE • CONSERVATION • URBAN DESIGN

RPCA St Brandon's House 29 Great George Street
Bristol BS1 5QT • 0117 974 2612
www.rpca.co.uk • info@rpca.co.uk



Project **SALINO LOUNGE** at 94-96 Parade,
Learnington Spa CV32 4AQ

Client **Loungers UK Ltd**

Title **Premises Licensing**

Drawing No. **LNG4937.05A**

Scale **1:75 @ A1** Date **FEB 2025**
1:150 @ A3

Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information to be taken from figured dimensions only.